




Enclosure Closed

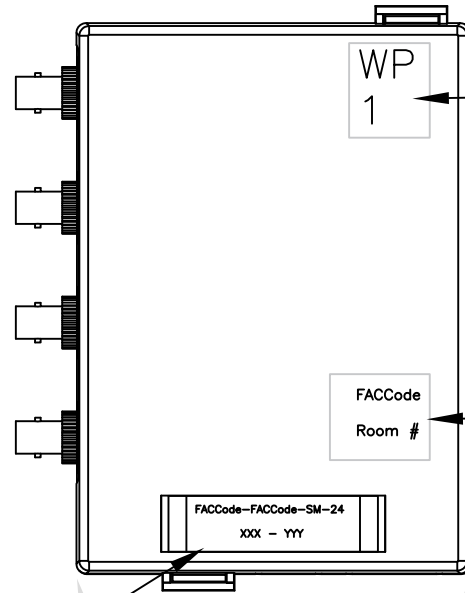


NUMBER WALL PANELS (WP) SEQUENTIALLY

Bldg FacCode Room # (Location of Panel)

XXX = MDF
YYY = IDF
TYPICAL

Fiber Splice Enclosure

All Labeling on Fire Alarm Panels & Fiber shall be Red Letters on White Background

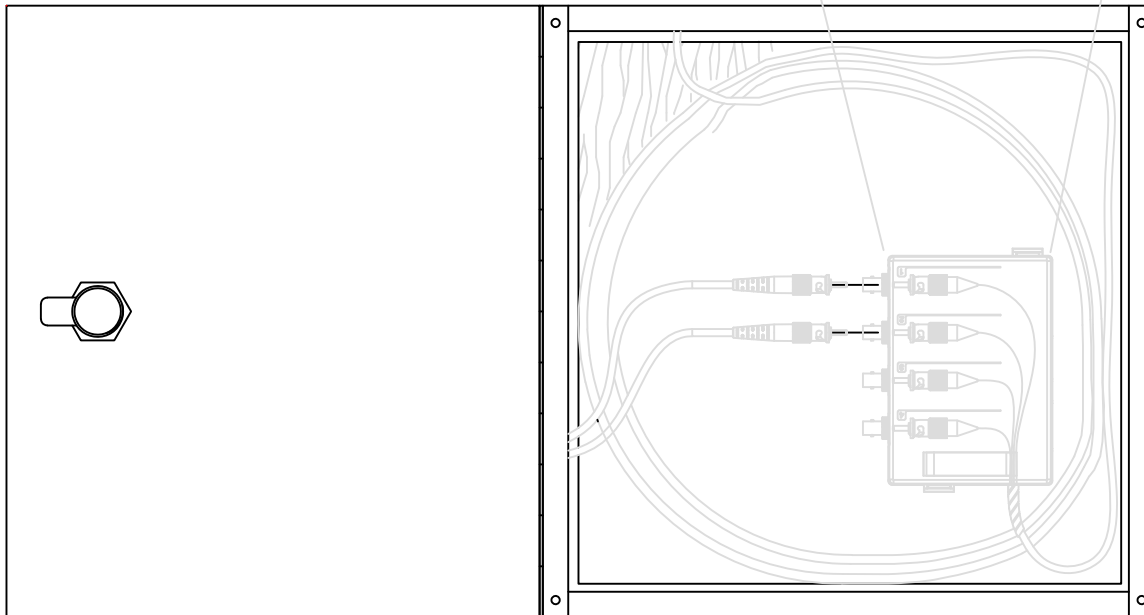

XXX = MDF
YYY = IDF
TYPICAL

FACCode-FACCode-SM-24
XXX - YYY

Fiber Optic Cable Tag (attach to cable)

Enclosure Open



UW-IT

FACILITIES PLANNING AND DESIGN

LABELING WALL MOUNTED FA ALARM ENCLOSURE

DRN. BY: J. Templin

CHECK: B. Jones

APPR: L. Zimmerman

DATE: 6/25/15

REV.: DATE:

REV. BY: J. Templin

SCALE:

SCALE/NTS

CAD NAME:

FA Pnl Label

DWG. NO.:

FE-CI-3